

Leitungshalter Typ PV
 Art.-Nr. 200 027 (Cu-Ausführung)
 Art.-Nr. 200 029 (NIRO-Ausführung)



MONTAGEANLEITUNG

1. Anwendung

Der Leitungshalter Typ PV für Leiter 6–8 mm Ø dient zur Verlegung von Blitzableiterleitungen an Regenfallrohren bis 123 mm Ø (oder an Profilen beliebiger Querschnittsformen bis max. 380 mm spannbarem Umfang).

2. Montage

2.1 Bei der Verlegung des Leiters **1** muß der Draht so eingelegt werden, daß der Leiter in die Rille des Spannbandanfangs **2** gelegt wird. Das Spannband wird um das Rohr oder Profil gelegt und durch die beiden Schlitze

- des Anschlußkopfes **3** gesteckt.
 Nach Festziehen des Spannbandes wird die Spannschraube **4** angezogen und somit Leiter und Band fixiert (siehe Bild 1).
 2.2 Eine 2. Rille ermöglicht bei Bedarf die Halterung eines weiteren Leiters.
 2.3 Die Verlegung am Regenfallrohr kann als Sichtverlegung oder auch versetzt (Anschlußkopf der Gebäudewand zugekehrt) erfolgen (siehe Bild 2).
 2.4 Ein Halterabstand von ca. 1,2 m sollte eingehalten werden.

Lieferform

Bild 1


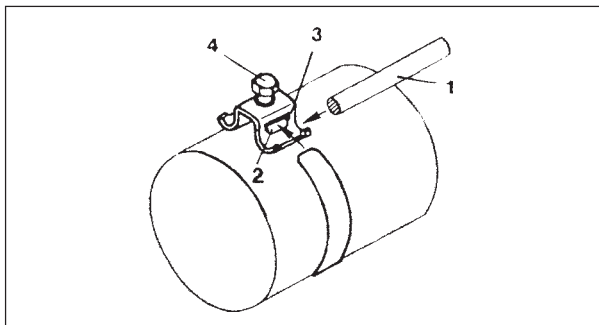


Bild 2

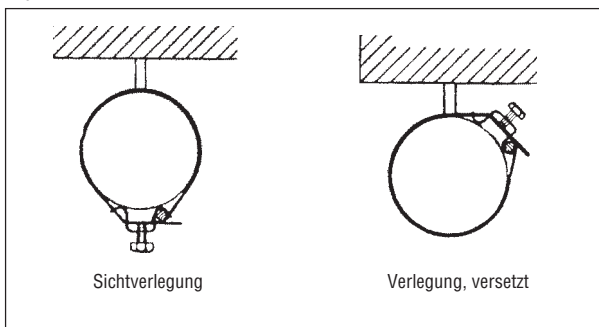

DEHN + SÖHNE GMBH + CO. KG.

Hans-Dehn-Str. 1
 Postfach 1640
 D-92306 Neumarkt
 Germany
 Tel.: 09181 / 906-0
 Fax: 09181 / 906-100

Conductor Holder Type PV
Art. No. 200 027 (copper version)
Art. No. 200 029 (NIRO version)



INSTALLATION INSTRUCTIONS

1. Application

The conductor holder type PV for conductors of 6-8 mm \varnothing is used for fixing lightning down conductors to down-pipes of up to 123 mm \varnothing (or to sectional supports of any cross-sectional shape up to a clamping size of 380 mm).

2. Installation

2.1 When fixing the conductor **1**, the wire must be inserted so that the conductor is laid in the channel at the start of the retaining strap **2**. The retaining strap is laid around the pipe or sectional support and fed

through the two slots of the clamping head **3**.

The retaining strap is pulled tight and the retaining screw **4** is tightened to fix the conductor and the strap (see fig. 1).

2.2 The 2nd channel of the holder can be used to hold another conductor if required.

2.3 The holder can be fixed to the down-pipe in a visible position or offset (clamping head facing the wall of the building) (see fig. 2).

2.4 The holders should be fixed at intervals of approx. 1.2 m.

Shape as delivered

Fig. 1


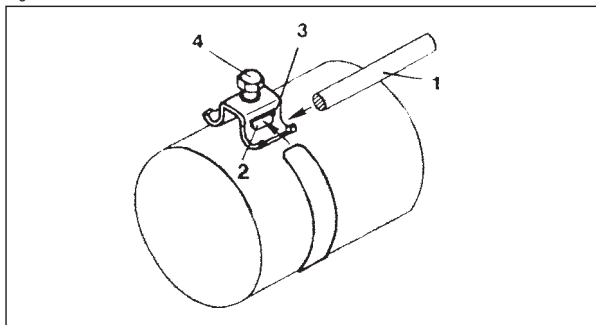


Fig. 2

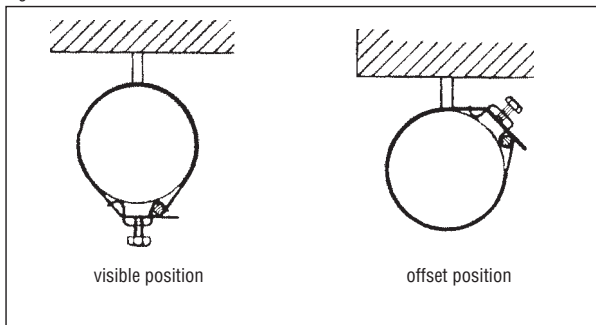

DEHN + SÖHNE GMBH + CO. KG.

Hans-Dehn-Str. 1
 Postbox1640
 92306 Neumarkt
 Germany
 Tel.: +49 91 81 906 0
 Fax: +49 91 81 906 100